



Technical Data Sheet

Product: LORIS 2%CHG Solution (Bottle 500 ml, E/F)

Product Code: 108-02

DIN 02358018 (Canada)

Product Packaging

Solution content: 490 – 510 mL

Number of bottles per corrugate: 12

Corrugates per layer: 19

Layers per skid: 4


Product Label

Intended use: Antiseptic cleanser for personal/ domestic use, effective in destroying certain bacteria and removing impurities to provide antiseptic cleansing.

Directions: Open bottle and use as part of a daily cleansing routine.

Warnings: For external use only. Avoid contact with the eyes. If contact occurs, flush eyes with water. Discontinue use and consult a health care practitioner if irritation develops.

Caution: Keep in a cool and dry place between 15°C and 30°C (59°F - 86°F).

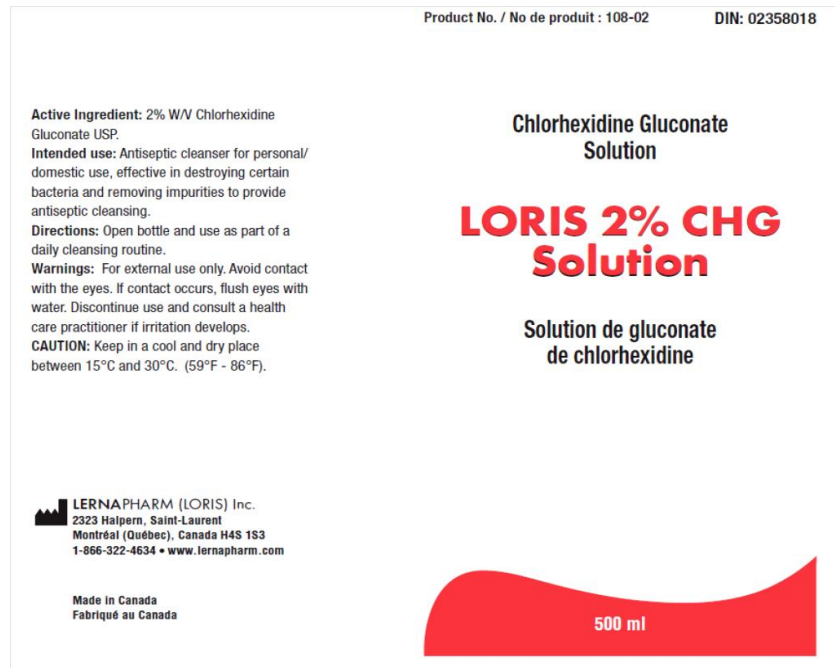

Front label view

Technical Data Sheet

Ingrédient actif: gluconate de chlorhexidine
2% P/V USP.

Usage: Nettoyant antiseptique pour usage domestique et à des soins d'hygiène personnelle, efficace pour détruire certaines bactéries et déloger les impuretés.

Mode d'emploi: Ouvrir la bouteille et utiliser dans le cadre de la routine du nettoyage quotidien.

Mise en garde: Pour usage externe seulement. Éviter tout contact avec les yeux. Le cas échéant, rincer abondamment les yeux avec de l'eau. Si une irritation apparaît, cesser d'utiliser le produit et consulter un praticien de soins de santé.

PRÉCAUTIONS: Entreposer dans un endroit sec et frais entre 15°C et 30°C. (59°F - 86°F).



Back label view

In-Process Quality Controls on Finished Products

Test	Method	Specification
Fill volume	S-MAN-003	Minimum 490 mL
Seal Integrity	Visual	No leaks found when a bottle is shaken upside down



Technical Data Sheet

Chemical / Biological Analysis

Test	Method	Specification
Description	Organoleptic	Bottle containing clear colorless liquid
Visual inspection	Organoleptic	The solution is free of dirt, hair, precipitates, and other foreign matter
Identification B	TL-S-QUA-045	The principal spot from the sample solution corresponds in color, size, and Rf value to that from the standard solution
Assay Chlorhexidine Gluconate (to be done on bulk solution)	NPLC-1262	1.8% - 2.2%
pH (to be done on bulk solution)	USP<791>	5.0-8.0
p-Chloroaniline (to be done on bulk solution)	NPLC-1263	≤ 100 µg/mL
Total Aerobic Microbial Count (TAMC)	TL-S-QUA-028	Report < 10 cfu/mL
Total Combined Yeast and Molds Count (TYMC)	TL-S-QUA-028	Report < 2 cfu/mL
S.aureus	TL-S-QUA-053	Absence
P.aeruginosa	TL-S-QUA-053	Absence
B.cepacia	TL-S-QUA-053	Absence